


- Clear a straight path from the transformer to the meter base on the house.
- Have your electrician mount the meter base on the transformer or stub-out side of the house as early as possible.
- Avoid placing building materials in the electric service path to avoid delays in service installation.
- Call us when the meter base is set and grading is within 6 inches of final grade. Mark all underground lines (especially septic and sprinkler). We can then install the underground conductor before landscaping!
- Notify us to disconnect the temporary service when ready.

OVERHEAD CONNECTION

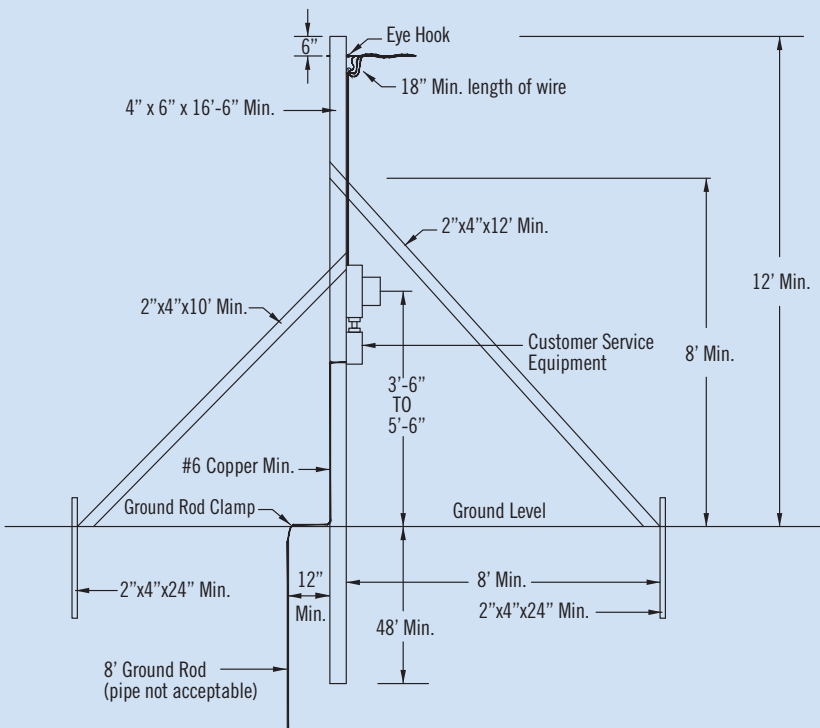

Overhead Temporary

Walton EMC also offers...



770.267.2505
walgongas.com

Make one call for your electric and natural gas service.



770-963-0305
emcsecurity.com

- Alarm.com – monitor construction sites via the internet
- Home Theater pre-wiring & design
- Central Vacuum Systems – Dirt Devil
- Home Security Systems
- Distributed Audio Systems for the whole house
- Structured Wiring Systems – Smart House for true speed data, voice and cable connections



770-267-2505
waltonemc.com

Revised 06-20



Are you building a home?

Steps to Great Electric Service

Steps to Great Service...

1 Call our office at 770-267-2505 to apply for service.

2 Ask for customer service. They'll set up your account. We'll need your name, company name, address, subdivision, lot number, street address, phone number and SSN/federal tax ID number.

3 Request the **type of temporary service.**

- **Standard** – specific to each house. The meter on the temporary pole will be moved to the house when permanent service is requested.
- **Floating** – serves multiple sites. A different meter will be installed on the finished house for permanent service.

4 Ask to set up an appointment with a engineering technician at your job site. The technician will look at your job and make suggestions to get your project the best possible electrical service.




METER BASE INSTALLATION:

- Installed by your electrician
- Must be ringless type
- Provide minimum 3" raceway for WEMC service conductors
- Minimum 8' ground rod driven in undisturbed soil


Local code authorities may have additional requirements.
For more details, see Walton EMC's Metering Guide at waltonemc.com

UNDERGROUND CONNECTIONS

Underground Temporary

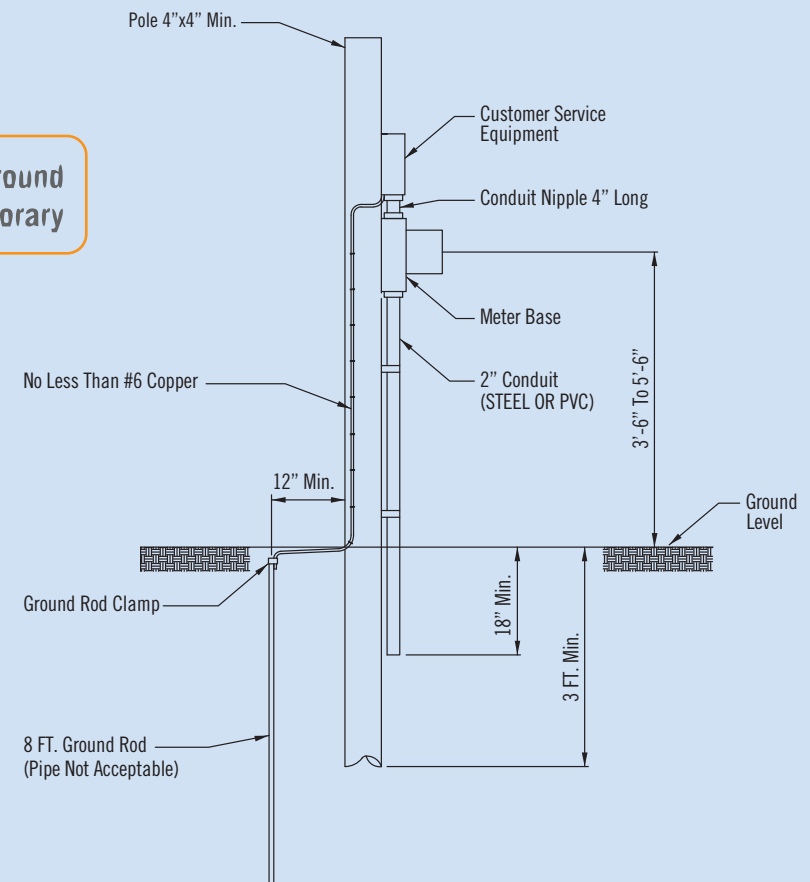

200 Amp Underground

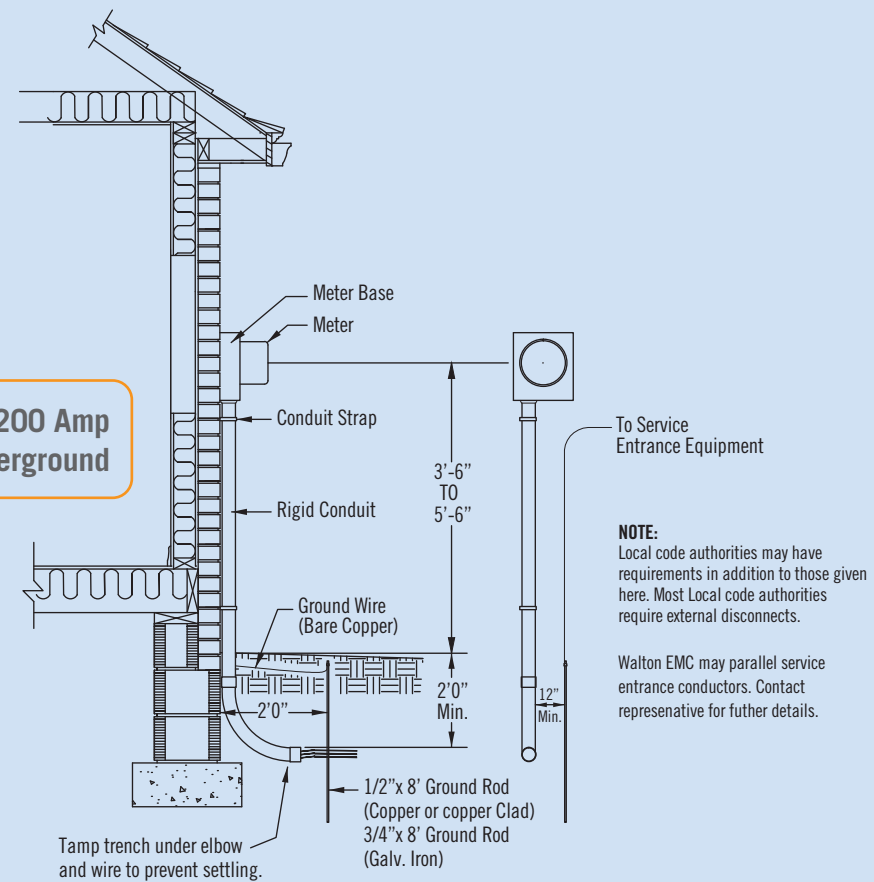

300-400 Amp Underground

- NOTE:**
- 1) All 320A Sockets Must Have A By-Pass Lever
 - 2) Socket May Be Used For 120/208Y Service If So, Fifth Terminal Meter Jaw Is Required In 9 O'Clock Position
 - 3) Walton EMC May Install Only 1(One) Run Of Service Conductor

